



AHERA/NESHAP ASBESTOS INSPECTION REPORT

CLIENT:

Sylvia Frierson
City of Sumter
13 E Canal Street
Sumter, SC 29150

LOCATION:

26 Brent Street
Sumter, SC

DATE OF INSPECTION:

November 30, 2020

DATE OF REPORT:

January 4, 2021

PREPARED BY:

Allyson Bowen, MPH
SC DHEC AHERA Asbestos Building Inspector No. BI-01566
SC DHEC Asbestos Supervisor No. SA-03051
SC DHEC Asbestos Air Sampler No. AS-00542
SC DHEC Asbestos Project Designer No. PD-00215
Expiration Date: September 8, 2021

SUMMIT Engineering, Laboratory & Testing, P.C. (**SUMMIT**)
3575 Centre Circle
Fort Mill, SC 29715
704-504-1717

SUMMIT Job No. 5563.E0007

AHERA/NESHAP ASBESTOS INSPECTION REPORT
26 Brent Street
Sumter, SC

TABLE OF CONTENTS

<u>SECTION</u>	<u>PAGE</u>
TABLE OF CONTENTS	ii
LIST OF APPENDICES	ii
1.0 REPORT CERTIFICATION	1
2.0 EXECUTIVE SUMMARY	2
3.0 SUSPECT MATERIALS	3
3.1 Ceiling Texture	3
3.2 Ceiling Texture	3
3.3 Drywall and Joint Compound	3
3.4 Floor Tiles	3
3.5 Sheet Flooring	4
3.6 Window Glaze	4
3.7 Roofing Systems	4
4.0 CONCLUSIONS AND RECOMMENDATIONS	5

FIGURES

- 1.0 Site Location Map

LIST OF APPENDICES

- A Analytical Results
B Asbestos Inspector's License
C SUMMIT Documentation

1.0 REPORT CERTIFICATION

SUMMIT is pleased to provide environmental consulting services for Sylvia Frierson with the City of Sumter. Please contact this office at 704-504-1717 with any questions or comments regarding the findings submitted in this report.

This document, entitled *AHERA/NESHAP Asbestos Inspection Report*, was prepared for Sylvia Frierson with the City of Sumter, and the South Carolina Department of Health and Environmental Control with sound practices and procedures and in accordance with Asbestos Hazard Emergency Response Act (AHERA), Title II of the Toxic Substance Control Act (TSCA), SCDHEC Regulation 61-86.1, 40 CFR 61, and 40 CFR 763 for Asbestos Containing Materials (ACM) guidance. The results obtained by the work documented in this report fulfill the requirements of federal, state, and local regulations regarding Asbestos Containing Materials.



January 4,
2021

Allyson Bowen, MPH
SC DHEC Asbestos Inspector No. BI-01566
Expiration Date: September 10, 2021
SC DHEC AHERA Supervisor No. SA-03051
Expiration Date: September 9, 2021
SC DHEC Asbestos Air Sampler No. AS-00542
Expiration Date: September 9, 2021
SC DHEC Asbestos Project Designer No. PD-00215
Expiration Date: September 8, 2021

Date

2.0 EXECUTIVE SUMMARY

On November 30, 2020, SUMMIT Engineering, Laboratory & Testing, P.C. (**SUMMIT**) performed an AHERA/NESHAP Asbestos Inspection for Sylvia Frierson with the City of Sumter at a residential structure located at 26 Brent Street in Sumter, SC. The structure is currently vacant and will be demolished. The structure is approximately 950 square feet in size. The sample areas featured ceiling texture, drywall and joint compound, floor tiles, sheet flooring, window glaze, and roofing systems.

The purpose of this inspection was to investigate available records for the specification of asbestos containing material (ACM), inspect for suspect materials, sample and analyze suspect materials to test for asbestos, and assess the condition and location of the ACM and other characteristics of the structure. Materials were sampled by a licensed asbestos inspectors, Allyson Bowen and Belinda Campbell, of **SUMMIT** Engineering.

A homogeneous material is a material that appears to be uniform when properties such as age, color, and texture are compared. Seven (7) homogeneous areas were sampled. The homogeneous areas are described in detail in section 3.0 of this report.

Zero (0) asbestos containing materials were identified within the structure.

3.0 SUSPECT MATERIALS

3.1 Ceiling Texture

CTEX-01-01- through 03

The ceiling texture was sampled from the living room. The results indicated that these materials are not classified as Asbestos Containing Materials (ACM). The materials are classified as friable, surfacing materials and are in good condition with a low potential for damage. The sample analysis of the material is enclosed in Appendix A. A detailed map showing the locations of the sampling locations can be found in the SUMMIT Documentation.

3.2 Ceiling Texture

CTEX-02-01- through 03

The ceiling texture was sampled from bedroom 2. The results indicated that these materials are not classified as Asbestos Containing Materials (ACM). The materials are classified as friable, surfacing materials and are in good condition with a low potential for damage. The sample analysis of the material is enclosed in Appendix A. A detailed map showing the locations of the sampling locations can be found in the SUMMIT Documentation.

3.3 Drywall and Joint Compound

DW-01-01- through 05

The drywall and joint compound were sampled from the ceilings in various areas throughout the residence. The results indicated that these materials are not classified as Asbestos Containing Materials (ACM). The materials are classified as friable, surfacing materials and are in good condition with a low potential for damage. The sample analysis of the material is enclosed in Appendix A. A detailed map showing the locations of the sampling locations can be found in the SUMMIT Documentation.

3.4 Floor Tiles

FT-01-01- through 03

The floor tiles were sampled from bedroom 1. The results indicated that this material is not classified as an Asbestos Containing Material (ACM). The material is classified as a non-friable, miscellaneous material and is in good condition with a low potential for damage. The sample analysis of the material is enclosed in Appendix A. A detailed map showing the locations of the sampling locations can be found in the SUMMIT Documentation.

3.5 Sheet Flooring

Sf-01-01- through 03

The sheet flooring was sampled from the bathroom. The results indicated that the sheet flooring is not classified as an Asbestos Containing Material (ACM). The material is classified as non-friable, miscellaneous material and is in good condition with a low potential for damage. The sample analysis of the material is enclosed in Appendix A. A detailed map showing the locations of the sampling locations can be found in the SUMMIT Documentation.

3.6 Window Glaze

WG-01-01- through 03

The window glaze was sampled from the windows. The results indicated that this material is not classified as an Asbestos Containing Material (ACM). The material is classified as a friable, miscellaneous material and is in damaged condition with a low potential for damage. The sample analysis of the material is enclosed in Appendix A. A detailed map showing the locations of the sampling locations can be found in the SUMMIT Documentation.

3.7 Roofing Systems

RS-01-01- through 03

The roofing systems were sampled from the roof. The results indicated that these materials are not classified as Asbestos Containing Materials (ACM). The materials are classified as non-friable, miscellaneous materials and are in good condition with a low potential for damage. The sample analysis of the material is enclosed in Appendix A. A detailed map showing the locations of the sampling locations can be found in the SUMMIT Documentation.

4.0 CONCLUSIONS AND RECOMMENDATIONS


On November 30, 2020, SUMMIT Engineering, Laboratory & Testing, P.C. (**SUMMIT**) performed an AHERA/NESHAP asbestos inspection at 26 Brent Street, Sumter SC.

SUSPECT MATERIAL	ACM (Y/N)	FRIABLE (Y/N)	AMOUNT (Square feet)
Ceiling Texture (CTEX-01)	N	Y	200
Ceiling Texture (CTEX-02)	N	Y	200
Drywall Joint Compound (DW-01)	N	Y	950
Floor Tile (FT-01)	N	N	100
Sheet Flooring (SF-01)	N	N	50
Window Glaze (WG-01)	N	Y	100
Roofing Systems (RS-01)	N	N	950


If the structure is to be renovated or demolished, a copy of this report and a notification of demolition or renovation forms must be submitted to The South Carolina Department of Health and Environmental Control (SCDHEC) at least ten working days prior to these activities taking place.

Bidders are responsible for their own calculations and estimates of quantities. Actual quantities may be more or less than indicated. Though every effort was made to examine wall cavities and other areas for pipe insulation, spray-applied or trowel applied miscellaneous material or other miscellaneous materials and other Presumed Asbestos Containing Material (PACM), this survey and report only deals with accessible areas of the building. There may be additional inaccessible areas above ceiling, behind walls and below floors that become evident during demolition or renovation activities. If suspect materials are found, additional asbestos testing may be required.

FIGURES

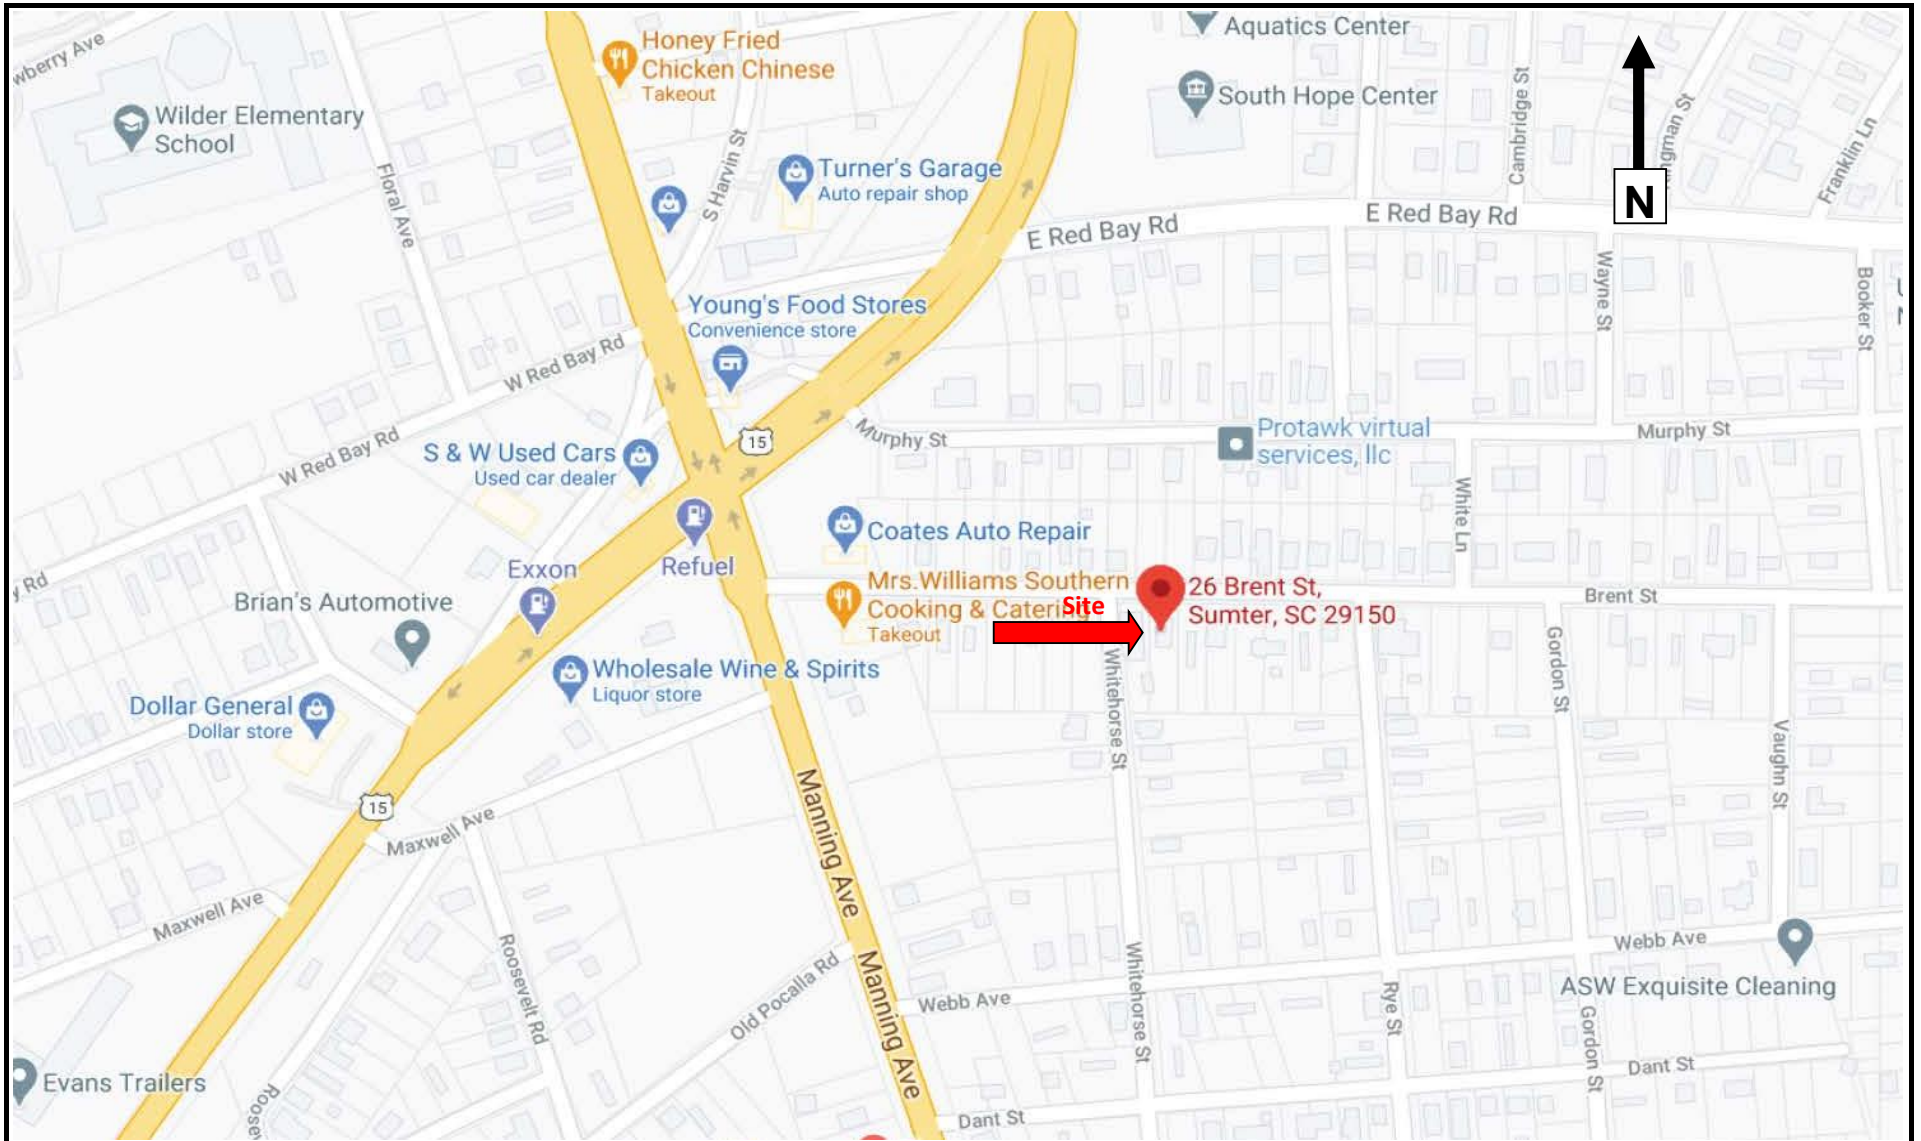

Source: Base Map provided by Online sources

	<p align="center">Site Location Map</p> <p align="center">26 Brent Street Sumter, SC</p>	<p align="center">Chris Hilditch City of Sumter</p>	<p>Prepared By\Date: AB/1/21 Checked By\Date: PL/1/21 Scale</p> <p align="center">Not to Scale</p> <p align="right">Figure 1</p>
---	---	---	--

APPENDIX A

ANALYTICAL RESULTS



CHAIN OF CUSTODY

LAB USE ONLY:
 Summit Order Number: 2021-1-5-5563-E0007

3575 Centre Circle, Fort Mill, SC 29715
 Tel: 704-504-1717; Fax: 704-504-1125

COMPANY CONTACT INFORMATION	
Company: <u>Summit</u>	Job Contact: <u>A. Bowen</u>
Address: <u>3575 Centre Circle</u>	Email: <u>abowen@summit-companies.com</u>
<u>Fort Mill, SC 29715</u>	Tel: <u>803-391-1863</u>
	Fax:
Project Name: <u>20 Brent Street.</u>	State Collected In: <u>SC</u>
Project ID #: <u>5563-E0007</u>	

ASBESTOS	METHOD	TURN AROUND TIME						
		4 HR	8 HR	12 HR	1 DAY	2 DAY	3 DAY	5 DAY
PLM BULK	EPA 600	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
PCM AIR	NIOSH 7400	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
POSITIVE STOP ANALYSIS: <input checked="" type="checkbox"/>								

COMMENTS: <u>TEM by 1/7/2021</u>		<input checked="" type="checkbox"/> Accept Samples	
		<input type="checkbox"/> Reject Samples	
Relinquished By:	Date/Time	Received By:	Date/Time
<u>[Signature]</u>	<u>1/4/2021</u>	<u>[Signature]</u>	<u>1/5/21</u>

Samples will be disposed of 60 days after analysis



SAMPLING FORM

LAB USE ONLY:
 Summit Order Number:

COMPANY CONTACT INFORMATION

Company: *Summit* Job Contact: *A. Bowen*
 Project Name: *218 Brent Street*
 Project ID #: *SSUB · F0007* Tel: *603 · 391 · 1843*

SAMPLE ID#	DESCRIPTION / LOCATION	VOLUME/AREA	DATE/TIME SAMPLED
CT-01-01	Ceiling Texture Living RM	PLM	
-02	↓ ↓	↓	
-03	↓ ↓	↓	
CT-02-01	Ceiling Texture Bedroom 2		
-02	↓ ↓		
-03	↓ ↓		
DW-01-01	Drywall J.C ceilings		
-02	↓ ↓		
-03	↓ ↓		
-04	↓ ↓		
-05	↓ ↓		
FT-01-01	Floor Tile Bedroom 1		
-02	↓ ↓		
TEM -03	↓ ↓	TEM	
SF-01-01	Sheet Flooring Bathroom	PLM	
-02	↓ ↓	↓	
TEM -03	↓ ↓	TEM	
WA-01-01	Window Glaze Windows	PLM	
-02	↓ ↓	↓	
TEM -03	↓ ↓	TEM	
RS-01-01	Roof Systems Roof	PLM	
-02	↓ ↓	↓	
TEM -03	↓ ↓	TEM	

Asbestos Laboratory Report

Prepared for

Summit ELT, P.C.

Project: 26 Brent Street

Summit #: 2021-1-5-5563.E0007

Date Analyzed: 1/7/2021

Date Reported: 1/7/2021

Total Samples Analyzed: 26

Samples >1% Asbestos: 0

Method of Analysis: EPA 600 / R93 / 116



Summit Laboratories

3575 Centre Circle, Fort Mill, SC 29715 Summit Order: 2021-1-5-5563.E0007
 Phone: (704) 504-1717

Summit ELT, P.C.
3575 Centre Circle
Fort Mill, SC 29715

Date Received: 1/5/2021

Date Analyzed: 1/7/2021

Date Reported: 1/7/2021

Project : 26 Brent St.

Test Report: Asbestos Analysis of Bulk Material via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample ID	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous (other)	% Asbestos
CT 1-1 2021-1-5-5563.E0007-1	Ceiling Texture	White Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
CT 1-2 2021-1-5-5563.E0007-2	Ceiling Texture	White Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
CT 1-3 2021-1-5-5563.E0007-3	Ceiling Texture	White Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
CT 2-1 2021-1-5-5563.E0007-4	Ceiling Texture	White Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
CT 2-2 2021-1-5-5563.E0007-5	Ceiling Texture	White Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
CT 2-3 2021-1-5-5563.E0007-6	Ceiling Texture	White Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
DW 1-1-Drywall 2021-1-5-5563.E0007-7	Drywall & JC	Gray,Brown Fibrous Homogeneous	10% Cellulose	90% Non-fibrous (other)	None Detected
DW 1-1-Joint Compound 2021-1-5-5563.E0007-7A	Drywall & JC	White Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
DW 1-2-Drywall 2021-1-5-5563.E0007-8	Drywall & JC	Gray,Brown Fibrous Homogeneous	10% Cellulose	90% Non-fibrous (other)	None Detected
DW 1-2-Joint Compound 2021-1-5-5563.E0007-8A	Drywall & JC	White Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
DW 1-3-Drywall 2021-1-5-5563.E0007-9	Drywall & JC	Gray,Brown Fibrous Homogeneous	10% Cellulose	90% Non-fibrous (other)	None Detected
DW 1-3-Joint Compound 2021-1-5-5563.E0007-9A	Drywall & JC	White Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
DW 1-4-Drywall 2021-1-5-5563.E0007-10	Drywall & JC	Gray,Brown Fibrous Homogeneous	10% Cellulose	90% Non-fibrous (other)	None Detected
DW 1-4-Joint Compound 2021-1-5-5563.E0007-10A	Drywall & JC	White Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected



Summit Laboratories

3575 Centre Circle, Fort Mill, SC 29715 Summit Order: 2021-1-5-5563.E0007
 Phone: (704) 504-1717

Summit ELT, P.C.
3575 Centre Circle
Fort Mill, SC 29715

Date Received: 1/5/2021

Date Analyzed: 1/7/2021

Date Reported: 1/7/2021

Project : 26 Brent St.

Test Report: Asbestos Analysis of Bulk Material via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample ID	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Asbestos
DW 1-5-Drywall 2021-1-5-5563.E0007-11	Drywall & JC	Gray,Brown Fibrous Homogeneous	10% Cellulose	90% Non-fibrous (other)	None Detected
DW 1-5-Joint Compound 2021-1-5-5563.E0007-11A	Drywall & JC	White Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
FT 1-1 2021-1-5-5563.E0007-12	Floor Tile	Gray Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
FT 1-2 2021-1-5-5563.E0007-13	Floor Tile	Gray Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
SF 1-1-Flooring 2021-1-5-5563.E0007-14	Sheet Flooring	Tan Fibrous Homogeneous	10% Cellulose	90% Non-fibrous (other)	None Detected
SF 1-1-Mastic 2021-1-5-5563.E0007-14A	Sheet Flooring	Beige Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
SF 1-2-Flooring 2021-1-5-5563.E0007-15	Sheet Flooring	Tan Fibrous Homogeneous	10% Cellulose	90% Non-fibrous (other)	None Detected
SF 1-2-Mastic 2021-1-5-5563.E0007-15A	Sheet Flooring	Beige Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
WG 1-1 2021-1-5-5563.E0007-16	Window Glaze	White Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
WG 1-2 2021-1-5-5563.E0007-17	Window Glaze	White Non-fibrous Homogeneous		100% Non-fibrous (other)	None Detected
RS 1-1 2021-1-5-5563.E0007-18	Roof Systems	Black Fibrous Homogeneous	8% Glass	92% Non-fibrous (other)	None Detected
RS 1-2 2021-1-5-5563.E0007-19	Roof Systems	Black Fibrous Homogeneous	8% Glass	92% Non-fibrous (other)	None Detected



METHOD: EPA 600 / R93 / 116

For samples easily separated into homogeneous layers, each component will be analyzed separately. The sample may not be representative of the larger material in question. Interpretation and use of test results are the responsibility of the client. Due to the limitations of the EPA 600 Method, nonfriable organically bound materials (NOBs) such as vinyl floor tiles, mastic and roofing can be difficult to analyze by PLM. Reanalysis by Transmission Electron Microscopy (TEM) to verify results of <1% or None Detect for these materials is recommended.

This sheet may not be reproduced except with permission from Summit Laboratories. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the Federal Government.

Analyst(s): 
Maria Cao

Approved By: 
Michael Zavislak,
Approved Signatory

NVLAP Lab Code 600041-0

Summit Laboratories, 3575 Centre Circle, Fort Mill, SC 29715, Phone: (704) 504-1717



EMSL ANALYTICAL, INC.
LABORATORY-PRODUCTS-TRAINING

Asbestos Chain of Custody

EMSL Order Number (lab use only):

412100070

PHONE:
FAX:

Company Name : Summit ELT, P.C.		EMSL Customer ID:	
Street: 3575 Centre Circle		City: Fort Mill	State or Province: SC
Zip/Postal Code: 29715	Country: US	Telephone #:	Fax #:
Report To (Name): Ally Bowen		Please Provide Results via: <input type="checkbox"/> Fax <input checked="" type="checkbox"/> Email	
email Address: abowen@summit-companies.com		Purchase Order Number:	
Client Project ID: 26 Brent Street / 5563.E0007		EMSL Project ID (internal use only):	
State or Province Collected: SC		CT only <input type="checkbox"/> Commercial/Taxable <input type="checkbox"/> Residential/Tax Exempt	
EMSL-Bill to: <input type="checkbox"/> Same <input type="checkbox"/> Different - If bill to is different note instructions in comment. Third party billing requires written authorization from third party			
Turnaround Time (TAT) Options Please Check			
<input type="checkbox"/> 3 Hr ¹	<input type="checkbox"/> 4-4.5Hr ¹ <small>AHERA Only</small>	<input type="checkbox"/> 6 Hr ¹	<input checked="" type="checkbox"/> 24 Hr ¹
		<input type="checkbox"/> 32 Hr ²	<input type="checkbox"/> 48 Hr
		<input type="checkbox"/> 72 Hr	<input type="checkbox"/> 96 Hr
		<input type="checkbox"/> 1 Week	<input type="checkbox"/> 2 Week
<small>¹Premium Service Charge applies for 3 Hour TEM AHERA or EPA Level II TAT - you will be asked to sign an authorization form. TEM Air 3-6 Hour, please call ahead to schedule ² 32 Hour TAT available for select tests only; samples must be submitted by 11:30 am</small>			
PCM - Air <input type="checkbox"/> NIOSH 7400 <input type="checkbox"/> w/ OSHA 8hr. TWA PLM - Bulk (reporting limit) <input type="checkbox"/> PLM EPA 600/R-93/116 (<1%) <input type="checkbox"/> PLM EPA NOB (<1%) Point Count <input type="checkbox"/> 400 (<0.25%) <input type="checkbox"/> 1000 (<0.1%) Point Count w/Gravimetric <input type="checkbox"/> 400 (<0.25%) <input type="checkbox"/> 1000 (<0.1%) <input type="checkbox"/> NYS 198.1 (friable - NY) <input type="checkbox"/> NYS 198.6 NOB (non-friable-NY) <input type="checkbox"/> NYS 198.8 SOF-V <input type="checkbox"/> NIOSH 9002 (<1%)		TEM - Air¹ <input type="checkbox"/> AHERA 40 CFR, Part 763 <input type="checkbox"/> NIOSH 7402 <input type="checkbox"/> EPA Level II <input type="checkbox"/> ISO 10312 TEM - Bulk <input checked="" type="checkbox"/> TEM EPA NOB <input type="checkbox"/> NYS NOB 198.4 (non-friable-NY) <input type="checkbox"/> TEM EPA 600/R-93/116 with milling prep (<0.1%) TEM - Water: EPA 100.2 Fibers >10µm <input type="checkbox"/> Waste <input type="checkbox"/> Drinking All Fiber Sizes <input type="checkbox"/> Waste <input type="checkbox"/> Drinking	
		TEM- Settled Dust <input type="checkbox"/> Microvac - ASTM D 5755 <input type="checkbox"/> Wipe - ASTM D6480 <input type="checkbox"/> Carpet Sonication (EPA 600/J-93/167) Soil - Rock - Vermiculite (reporting limit) <input type="checkbox"/> PLM EPA 600/R-93/116 with milling prep (<0.25%) <input type="checkbox"/> TEM EPA 600/R-93/116 with milling prep (<0.1%) <input type="checkbox"/> TEM Qualitative via Filtration Prep <input type="checkbox"/> TEM Qualitative via Drop Mount Prep <input type="checkbox"/> Cincinnati Method EPA 600/R-04/004 - PLM/TEM <small>*Lower reporting limits available on request</small>	
		Other test (please specify):	
<input type="checkbox"/> Stop At First Positive (clearly identify homogenous areas below)		Filter Pore Size (Air Samples): <input type="checkbox"/> 0.8µm <input type="checkbox"/> 0.45µm	
Sampler's Name:		Sampler's Signature:	
Sample #	Sample Description/Location	Volume, Area or Homogenous Area	Date/Time Sampled
FT-01-03	Floor Tile		
SF-01-03	Sheet Floor, Mastic		
WG-01-03	Window Glaze		
RS-01-03	Roof Shingle		
Client Sample # (s): -		Total # of Samples:	
Relinquished by (Client): Christopher Estes		Date: 1/5/2021	Time: 8:00am
Received by (Lab): [Signature]		Date: 1/6/21	Time: 7:15am
Comments/Special Instructions: [Signature] PB			



EMSL Analytical, Inc.

10801 Southern Loop Blvd Pineville, NC 28134

Tel/Fax: (704) 525-2205 / (704) 525-2382

<http://www.EMSL.com> / charlottelab@emsl.com

EMSL Order: 412100070

Customer ID: SECS21A

Customer PO:

Project ID:

Attention: Ally Bowen
Summit Engineering & Construct. Services
3575 Centre Circle
Fort Mill, SC 29715

Phone: (803) 547-8107

Fax:

Received Date: 01/06/2021 7:15 AM

Analysis Date: 01/06/2021

Collected Date:

Project: 26 Brent Street/ 5563.E0007

Test Report: Asbestos Analysis of Non-Friable Organically Bound Materials by TEM via EPA/600/R-93/116 Section 2.5.5.1

Sample ID	Description	Appearance	% Matrix Material	% Non-Asbestos Fibers	Asbestos Types
FT-01-03 412100070-0001	Floor Tile	Gray Non-Fibrous Homogeneous	100.0 Other	None	No Asbestos Detected
SF-01-03-Flooring 412100070-0002	Sheet Floor, Mastic	Beige Fibrous Homogeneous	100.0 Other	None	No Asbestos Detected
SF-01-03-Mastic 412100070-0002A	Sheet Floor, Mastic	Tan Non-Fibrous Homogeneous	100.0 Other	None	No Asbestos Detected
WG-01-03 412100070-0003	Window Glaze	White Non-Fibrous Homogeneous	100.0 Other	None	No Asbestos Detected
RS-01-03 412100070-0004	Roof Shingle	Black Fibrous Homogeneous	100.0 Other	None	No Asbestos Detected

Analyst(s)

Derrick Young (5)

Lee Plumley, Laboratory Manager
or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. EMSL recommends that samples reported as none detected or <1% undergo additional analysis via PLM to avoid the possibility of false negatives.

Samples analyzed by EMSL Analytical, Inc. Pineville, NC

Initial report from: 01/06/2021 17:14:35

APPENDIX B

INSPECTOR'S LICENSES

SCDHEC ISSUED

Asbestos ID Card

Allyson Bowen



		Expiration Date:
AIRSAMPLER	AS-00542	09/09/21
CONSULTBI	BI-01566	09/10/21
CONSULTMP	MP-00276	09/10/21
CONSULTPD	PD-00215	09/08/21
SUPERAHERA	SA-03051	09/09/21

APPENDIX C

SUMMIT DOCUMENTATION

SITE PHOTOGRAPHS



This photo depicts the front of the residence.



This photo depicts another view of the exterior of the residence.



This photo depicts a view of the living room.



This photo depicts the ceiling texture in the living room.



This photo depicts a view of the kitchen.



This photo depicts the ceiling in the kitchen.



This photo depicts a view of the bedroom.



This photo depicts a view of the ceiling in the bedroom.



This photo depicts the floor tile in bedroom 1.



This photo depicts the sheet flooring sampled from the bathroom.

26
48 Brent Street. 48x20

Living Room:
ceiling texture
CT-01

Window glare
routing (shingles).

Attic Room:
DNJC on ceiling.
wood paneling.
carpet.

Kitchen
ceiling texture

Bed 1
Floor tile
sheet flooring

Bath
sheet flooring

Bedroom 2
Popcorn ceiling - CT-02
carpet.

